




## ZBIORNIK CIEPŁEJ WODY

Karta nr 2

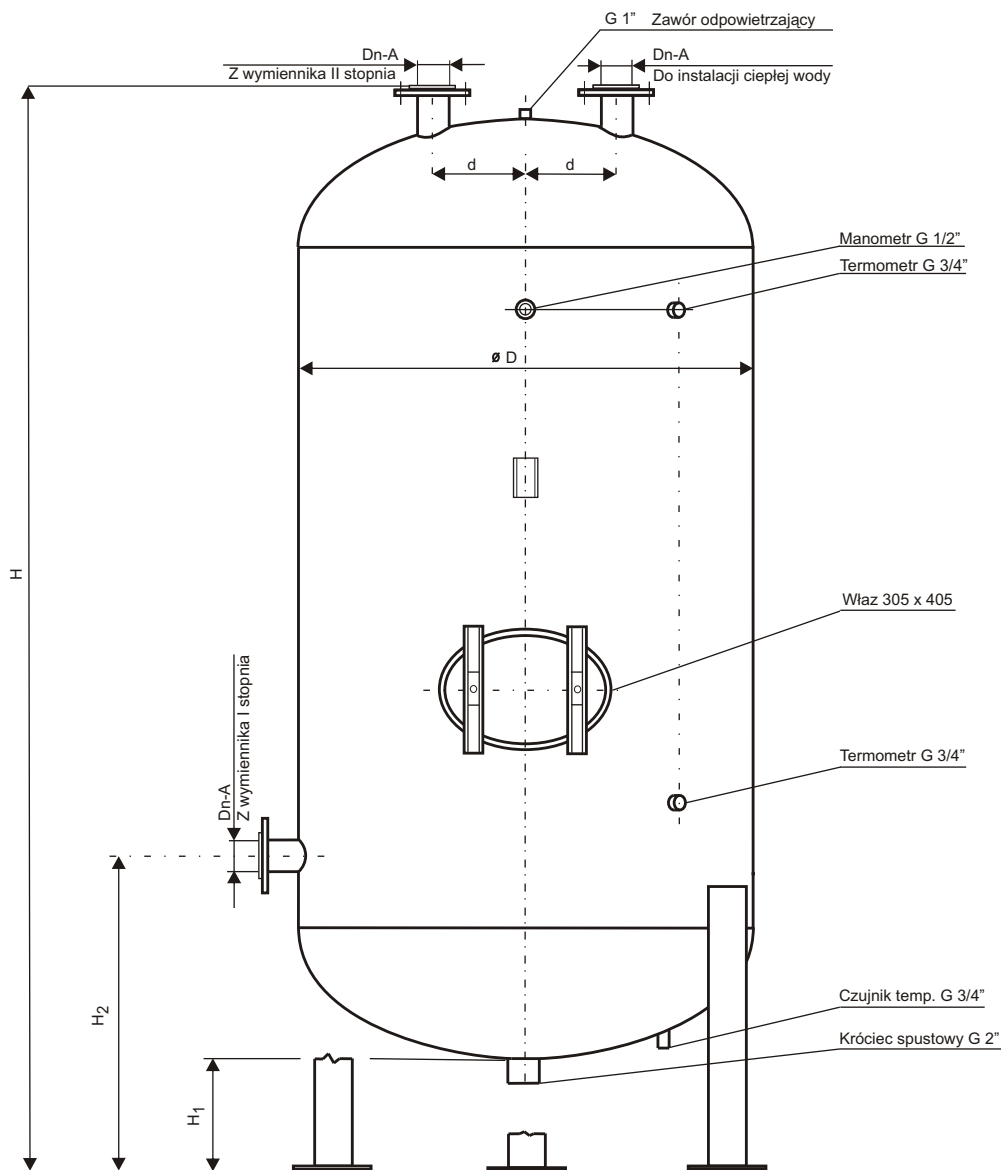

Zbiorniki są dopuszczone do magazynowania i dystrybucji wody przeznaczonej do spożycia w instalacjach budownictwa mieszkaniowego i przemysłowego przez Państwowy Zakład Higieny.

Lp.	TYP	V	PS		D	H	H1	H2	d	DN-A	Masa	
		Litry	6	10							kg/6bar	kg/10bar
1.	ZY-1000	1000	6	10	900	2027	200	571	180	65	295	343
2.	ZY-1500	1500	6	10	1000	2377	200	606	200	80	370	476
3.	ZY-2000	2000	6	10	1200	2227	200	664	250	100	465	615
4.	ZY-2500	2500	6	10	1200	2677	200	664	250	100	550	720
5.	ZY-3000	3000	6	10	1400	2427	200	714	300	100	580	860
6.	ZY-4000	4000	6	10	1400	3077	200	714	300	100	725	1070
7.	ZY-5000	5000	6	10	1600	3179	200	765	350	100	995	1400
8.	ZY-6000	6000	6	10	1600	3679	200	765	350	100	1145	1610
9.	ZY-8000	8000	6	10	1800	3781	200	816	400	100	1490	2210
10.	ZY-10000	10000	6	10	2000	3881	200	866	450	100	1700	2520